


2. head detail


NOTE:

Structural lintels should be in accordance with certified engineer's specifications. for openings over 3500mm steel lintels are recomended

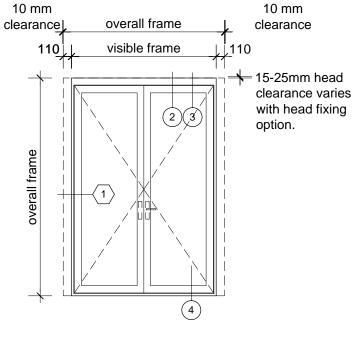

elevation key

head clearance varies subject to use of head support bracket. verify with Centor prior to construction of rough opening

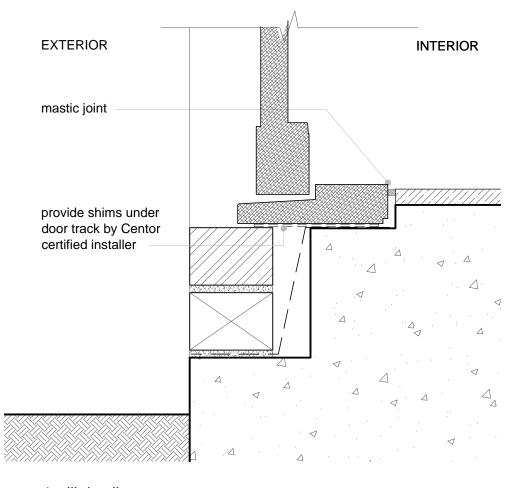

4. sill detail

 Date
 29 May 2015
 Pages
 1 of 1
 Page size A3

 Dwg No
 CD_APC_200.01
 Scale
 1:5 / 1:50
 Rev
 G

